



ETA-Danmark A/S
Göteborg Plads 1
DK-2150 Nordhavn
Tel. +45 72 24 59 00
Internet www.etadanmark.dk

Authorised and notified according
to Article 29 of the Regulation (EU)
No 305/2011 of the European Par-
liament and of the Council of 9
March 2011

MEMBER OF EOTA



European Technical Assessment ETA-25/0053 of 2025/03/10

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:

WASI self-tapping screws

Product family to which the above construction product belongs:

Screws and threaded rods for use in timber constructions

Manufacturer:

WASI GmbH
WASI-Strasse 1
D-42287 Wuppertal
Internet: www.wasi.de

Manufacturing plant:

WASI GmbH
WASI-Strasse 1
D-42287 Wuppertal

This European Technical Assessment contains:

25 pages including 4 annexes which form an integral part of the document

This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:

EAD 130118-01-0603: Screws and threaded rods for timber constructions

This version replaces:

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

II SPECIFIC PART OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of product

WASI screws are self-tapping screws to be used in timber structures. WASI screws shall be threaded over a part of the length or over the full length. The screws shall be produced from stainless steel wire for nominal diameters of 3,0 mm to 8,0 mm. Where corrosion protection is required, the material or coating shall be declared in accordance with the relevant specification given in Annex A of EN 14592.

Geometry and Material

The nominal diameter (outer thread diameter), d , shall not be less than 3,0 mm and shall not be greater than 8,0 mm. The overall length, L , of screws shall not be less than 16 mm and shall not be greater than 280 mm. Other dimensions are given in Annex A.

The ratio of inner thread diameter to outer thread diameter d_i/d ranges from 0,54 to 0,73.

The screws are threaded over a minimum length L_G of $4,0 \cdot d$ (i.e. $L_G \geq 4,0 \cdot d$).

The lead p (distance between two adjacent thread flanks) ranges from $0,43 \cdot d$ to $0,80 \cdot d$.

The screws covered by this ETA have a minimum bending angle, α , of $(45/d^{0,7} + 20)$ degrees.

2 Specification of the intended use in accordance with the applicable European Assessment Document (hereinafter EAD)

The screws are used for connections in load bearing timber structures between members of solid timber, glued laminated timber, cross-laminated timber, and laminated veneer lumber (softwood and hardwood), similar glued members, wood-based panels or steel.

WASI screws with diameters between 6 mm and 8 mm may also be used for the fixing of thermal insulation material on rafters and on vertical facades.

Steel plates and wood-based panels except solid wood panels and cross laminated timber shall only be located on the side of the screw head. The following wood-based panels may be used:

- Plywood according to EN 636 or ETA

- Particleboard according to EN 312 or ETA
- Oriented Strand Board, Type OSB/3 and OSB/4 according to EN 300 or ETA
- Fibreboard according to EN 622-2 and 622-3 or ETA (minimum density 650 kg/m³) or national provisions that apply at the installation site
- Cement bonded particleboard according to EN 634 or ETA
- Solid wood panels according to EN 13353 and EN 13986 and cross laminated timber according to ETA
- Laminated Veneer Lumber according to EN 14374 or European Technical Approval
- Engineered wood products according to ETA, provided that the ETA for the product provides provisions for the use of self-tapping screws and these provisions are applied

The screws shall be driven into the wood without pre-drilling or after pre-drilling.

The screws are intended to be used in timber connections for which requirements for mechanical resistance and stability and safety in use in the sense of the Essential Requirements 1 and 4 of Regulation 305/2011 (EU) shall be fulfilled.

The design of the connections shall be based on the characteristic load-carrying capacities of the screws. The design capacities shall be derived from the characteristic capacities in accordance with Eurocode 5 or an appropriate national code.

The screws are intended for use for connections subject to static or quasi static loading.

The stainless-steel screws are for use in timber structures subject to the conditions defined by the service classes 1, 2 or 3 of EN 1995-1-1:2008 (Eurocode 5).

The scope of the screws regarding resistance to corrosion shall be defined according to national provisions that apply at the installation site considering environmental conditions.

The provisions made in this European Technical Assessment are based on an assumed intended working life of the screws of 50 years.

The indications given on the working life cannot be interpreted as a guarantee given by the producer or Assessment Body but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

Characteristic	Assessment of characteristic
3.1 Mechanical resistance and stability*) (BWR1)	
Dimensions	See annex A
Characteristic yield moment	See section 3.4
Bending angle	No performance assessed
Characteristic withdrawal parameter	See section 3.4
Characteristic head pull-through parameter of screws	See section 3.4
Characteristic tensile strength	Characteristic value $f_{\text{tens,k}}$: Screw d = 3,0 mm: 2,6 kN Screw d = 3,5 mm: 2,6 kN Screw d = 4,0 mm: 3,5 kN Screw d = 4,5 mm: 4,3 kN Screw d = 5,0 mm: 5,4 kN Screw d = 5,5 mm: 7,0 kN Screw d = 6,0 mm: 7,4 kN Screw d = 8,0 mm: 14 kN
Characteristic yield strength	No performance assessed
Insertion moment	Ratio of the characteristic torsional strength to the mean insertion moment: $f_{\text{tor,k}} / R_{\text{tor,mean}} > 1,5$
Characteristic torsional strength	Characteristic value $f_{\text{tor,k}}$: Screw 91XX d = 3,0 mm: 1,2 Nm Screw 91XX d = 3,5 mm: 1,3 Nm Screw 91XX d = 4,0 mm: 2,0 Nm Screw 98XX d = 4,0 mm: 2,0 Nm Screw 91XX d = 4,5 mm: 2,6 Nm Screw 98XX d = 4,5 mm: 4,3 Nm Screw 91XX d = 5,0 mm: 4,0 Nm Screw 98XX d = 5,0 mm: 4,0 Nm Screw 98XX d = 5,5 mm: 5,8 Nm Screw 91XX d = 6,0 mm: 6,5 Nm Screw 91XX d = 8,0 mm: 20,0 Nm Screw 98XX d = 8,0 mm: 18,0 Nm
Spacing, end and edge distances of the screws or threaded rods and minimum thickness of the timber material	See annex B
Slip modulus for mainly axially loaded screws and threaded rods	See section 3.4
Durability against corrosion	See section 3.5
3.2 Safety in case of fire (BWR2)	
Reaction to fire	The screws are made from steel classified as class A1 in accordance with EN 13501-1 and Commission Delegated Regulation 2016/364.

*) See additional information in section 3.4 – 3.6

3.4 Mechanical resistance and stability

The load-carrying capacities for WASI screws are applicable to the wood-based materials mentioned in paragraph 1 even though the term timber has been used in the following.

The characteristic lateral load-carrying capacities and the characteristic axial withdrawal capacities of WASI screws should be used for designs in accordance with Eurocode 5 or an appropriate national code.

Point side penetration length must be $\ell_{ef} \geq 4 \cdot d$, where d is the outer thread diameter of the screw. For the fixing of thermal insulation on rafters, point side penetration must be at least 40 mm, $\ell_{ef} \geq 40$ mm.

Screws shall be driven in pre-drilled holes if the characteristic member density exceeds 500 kg/m³.

European Technical Assessments for structural members or wood-based panels must be considered where applicable.

For screws in pre-drilled holes, the drill hole diameter should be considered in the member strength verification both, in the tensile and compressive area of members, for screws driven without pre-drilling, the inner thread diameter.

For wood-based panels the relevant ETA's must be considered where applicable.

Lateral load-carrying capacity

The characteristic lateral load-carrying capacity of WASI screws shall be calculated according to EN 1995-1-1:2008 (Eurocode 5) using the outer thread diameter d as the effective diameter of the screw.

The characteristic yield moment is:

Screw $d = 3,0$ mm:	$M_{y,k} = 1,3$ Nm
Screw $d = 3,5$ mm:	$M_{y,k} = 1,3$ Nm
Screw $d = 4,0$ mm:	$M_{y,k} = 1,8$ Nm
Screw $d = 4,5$ mm:	$M_{y,k} = 2,5$ Nm
Screw $d = 5,0$ mm:	$M_{y,k} = 3,1$ Nm
Screw $d = 5,5$ mm:	$M_{y,k} = 5,0$ Nm
Screw $d = 6,0$ mm:	$M_{y,k} = 5,3$ Nm
Screw $d = 8,0$ mm:	$M_{y,k} = 14$ Nm

Where:

d outer thread diameter [mm]

The embedding strength for screws in non-pre-drilled holes in softwood arranged at an angle between screw axis and grain direction, $0^\circ \leq \varepsilon \leq 90^\circ$ is:

$$f_{h,k} = \frac{0,082 \cdot \rho_k \cdot d^{-0,3}}{2,5 \cdot \cos^2 \varepsilon + \sin^2 \varepsilon} \quad [\text{N/mm}^2]$$

and accordingly for screws in pre-drilled holes in softwood:

$$f_{h,k} = \frac{0,082 \cdot \rho_k \cdot (1 - 0,01 \cdot d)}{2,5 \cdot \cos^2 \varepsilon + \sin^2 \varepsilon} \quad [\text{N/mm}^2]$$

Where:

ρ_k characteristic timber density [kg/m³], with a maximum characteristic density of 550 kg/m³;
 d outer thread diameter [mm];
 ε angle between screw axis and grain direction.

The embedding strengths given above may be applied for screws within single softwood layers in cross laminated timber, if the single layer is considered as a separate softwood member and the minimum spacing, end and edge distances are observed for the single layer. For inner layers, the edge distance perpendicular to the grain may be reduced to $3 \cdot d$.

Alternatively, the embedding strength for screws arranged parallel to the plane of cross laminated timber (layers of softwood), independent of the angle between screw axis and grain direction, $0^\circ \leq \varepsilon \leq 90^\circ$, may be calculated from:

$$f_{h,k} = 20 \cdot d^{-0,5} \quad [\text{N/mm}^2]$$

unless otherwise specified in the technical specification (ETA or hEN) for the cross laminated timber.

Where:

d outer thread diameter [mm]

The embedding strength for screws in the wide face of cross laminated timber should be assumed as for solid timber based on the characteristic density of a board layer. If relevant, the angle between force and grain direction of the outer layer should be taken into account.

The lateral force component perpendicular to the screw axis must not be directed away to the member surface.

The embedding strength for screws in non-pre-drilled holes in softwood LVL arranged at an angle between screw axis and grain direction, $0^\circ \leq \varepsilon \leq 90^\circ$ is:

$$f_{h,k} = \frac{0,082 \cdot \rho_k \cdot d^{-0,3}}{(2,5 \cdot \cos^2 \varepsilon + \sin^2 \varepsilon)(1,5 \cdot \cos^2 \beta + \sin^2 \beta)} \quad [\text{N/mm}^2]$$

and accordingly for screws in pre-drilled holes in softwood LVL:

$$f_{h,k} = \frac{0,082 \cdot \rho_k \cdot (1 - 0,01 \cdot d)}{(2,5 \cdot \cos^2 \varepsilon + \sin^2 \varepsilon)(1,5 \cdot \cos^2 \beta + \sin^2 \beta)} \quad [\text{N/mm}^2]$$

Where:

ρ_k characteristic timber density [kg/m³]
 d outer thread diameter [mm]
 ε angle between screw axis and grain direction
 β angle between screw axis and the LVL's wide face ($0^\circ \leq \beta \leq 90^\circ$).

For laterally loaded screws, the rules for multiple fastener connections in EN 1995-1-1, 8.3.1.1 (8) should be applied.

The lateral slip modulus K_{ser} for the serviceability limit state of screws in non-predrilled holes is given in EN 1995-1-1 (Eurocode 5) clause 7.1 and table 7.1 as for nails in non-predrilled holes.

The lateral slip modulus K_{ser} for the serviceability limit state of screws in predrilled holes is given in EN 1995-1-1 (Eurocode 5) clause 7.1 and table 7.1 as for nails in predrilled holes.

Bending angle

No performance assessed.

Axial withdrawal capacity

The characteristic axial withdrawal capacity of WASI screws in solid timber (softwood with a maximum characteristic density of 550 kg/m³), glued laminated timber (softwood with a maximum characteristic density of 550 kg/m³), cross-laminated timber or laminated veneer lumber (softwood with maximum characteristic density of 550 kg/m³) members at an angle of $15^\circ \leq \varepsilon \leq 90^\circ$ to the grain shall be calculated according to EN 1995-1-1:2008 from:

$$F_{ax,\varepsilon,Rk} = \frac{n_{ef} \cdot k_{ax} \cdot f_{ax,k} \cdot d \cdot \ell_{ef} \left(\frac{\rho_k}{\rho_a} \right)^{0,8}}{k_\beta} \quad [N]$$

Where

$F_{ax,\varepsilon,Rk}$	characteristic withdrawal capacity of the screws at an angle ε to the grain [N]
n_{ef}	effective number of screws according to EN 1995-1-1:2008
k_{ax}	$k_{ax} = 1,0$ for $45^\circ \leq \varepsilon \leq 90^\circ$ $k_{ax} = a + \frac{b \cdot \alpha}{45^\circ}$ for $0^\circ \leq \varepsilon < 45^\circ$
	$a = \begin{cases} 0,5 & \text{for LVL} \\ 0,3 & \text{for timber} \end{cases}$
	$b = \begin{cases} 0,5 & \text{for LVL} \\ 0,7 & \text{for timber} \end{cases}$
k_β	$k_\beta = 1,0$ for timber $k_\beta = 1,5 \cdot \cos^2 \beta + \sin^2 \beta$ for LVL
$f_{ax,k}$	Characteristic withdrawal parameter

For screws 91XX in solid or glued laminated timber, cross laminated timber and SWP members with maximum characteristic density of 550 kg/m³ and $\rho_a = 350$ kg/m³:

$$\begin{aligned} 3 \text{ mm} \leq d \leq 3,5 \text{ mm} & \quad f_{ax,k} = 16 \text{ N/mm}^2 \\ 4 \text{ mm} \leq d \leq 8 \text{ mm} & \quad f_{ax,k} = 12 \text{ N/mm}^2 \end{aligned}$$

For screws 98XX in solid or glued laminated timber, cross laminated timber and SWP members with maximum characteristic density of 550 kg/m³ and $\rho_a = 350$ kg/m³:

	$4 \text{ mm} \leq d \leq 4,5 \text{ mm}$	$f_{ax,k} = 10 \text{ N/mm}^2$
	$5 \text{ mm} \leq d \leq 5,5 \text{ mm}$	$f_{ax,k} = 11 \text{ N/mm}^2$
	$d = 8,0 \text{ mm}$	$f_{ax,k} = 12 \text{ N/mm}^2$
d	outer thread diameter [mm]	
ℓ_{ef}	penetration length of the threaded part according to EN 1995-1-1:2008 [mm]	
ε	angle between grain and screw axis, $15^\circ \leq \varepsilon \leq 90^\circ$,	
β	angle between screw axis and the LVL's wide face ($0^\circ \leq \beta \leq 90^\circ$)	
ρ_k	characteristic density [kg/m ³]	
ρ_a	associated density for $f_{ax,k}$ [kg/m ³]	

For screws penetrating more than one layer of cross laminated timber, the different layers may be taken into account proportionally.

The axial withdrawal capacity for screws arranged parallel to the plane of cross laminated timber, independent of the angle between screw axis and grain direction, $0^\circ \leq \varepsilon \leq 90^\circ$, may be calculated from:

$$F_{ax,Rk} = 20 \cdot d^{0,8} \cdot \ell_{ef}^{0,9} \quad [N]$$

Where:

d	outer thread diameter [mm]
ℓ_{ef}	Penetration length of the threaded part according to EN 1995-1-1:2008 [mm]

The axial withdrawal capacity is limited by the head pull-through capacity and the tensile capacity of the screw.

For axially loaded screws in tension, where the external force is parallel to the screw axes, the rules in EN 1995-1-1, 8.7.2 (8) should be applied.

For inclined screws in timber-to-timber or steel-to-timber shear connections, where the screws are arranged under an angle $30^\circ \leq \varepsilon \leq 60^\circ$ between the shear plane and the screw axis, the effective number of screws n_{ef} should be determined as follows:

For one row of n screws parallel to the load, the load-carrying capacity should be calculated using the effective number of fasteners n_{ef} , where:

$$n_{ef} = \max \{ n^{0,9} ; 0,9 \cdot n \}$$

and n is the number of inclined screws in a row. If crossed pairs of screws are used in timber-to-timber connections, n is the number of crossed pairs of screws in a row.

Note: For inclined screws as fasteners in mechanically jointed beams or columns or for the fixing of thermal insulation material or for shear connections in shear walls and diaphragms, $n_{ef} = n$.

The axial slip modulus K_{ser} of the threaded part of a screw for the serviceability limit state should be taken independent of angle ε to the grain as:

$$K_{ser} = 25 \cdot d \cdot \ell_{ef} \text{ [N/mm]} \text{ for fasteners in softwood}$$

Where

d outer thread diameter [mm]

ℓ_{ef} penetration length in the timber member [mm]

Head pull-through capacity

The characteristic head pull-through capacity of WASI screws in softwoods, hardwoods and wood-based panels shall be calculated according to EN 1995-1-1:2008 from:

$$F_{ax,\varepsilon,Rk} = n_{ef} \cdot f_{head,k} \cdot d_h^2 \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0,8} \quad [N]$$

where:

$F_{ax,\varepsilon,Rk}$ characteristic head pull-through capacity of the connection at an angle $\varepsilon \geq 30^\circ$ to the grain [N]

n_{ef} effective number of screws according to EN 1995-1-1:2008

For inclined screws: $n_{ef} = \max \{ n^{0,9} ; 0,9 \cdot n \}$
(see axial withdrawal capacity)

$f_{head,k}$ characteristic head pull-through parameter [N/mm²]

d_h diameter of the screw head or the washer [mm]. Outer diameter of washers $d_k > 32$ mm shall not be considered.

ρ_k characteristic density [kg/m³], for wood-based panels maximum $\rho_k = 380$ kg/m³

Characteristic head pull-through parameter for WASI screws in connections with softwood and in connections with wood-based panels with thicknesses above 20 mm and $\rho_a = 350$ kg/m³:

$$f_{head,k} = 9,4 \text{ N/mm}^2$$

Characteristic head pull-through parameter for screws in connections with wood-based panels with thicknesses between 12 mm and 20 mm:

$$f_{head,k} = 8 \text{ N/mm}^2$$

Screws in connections with wood-based panels with a thickness below 12 mm (minimum thickness of the wood based panels of $1,2 \cdot d$ with d as outer thread diameter):

$$f_{head,k} = 8 \text{ N/mm}^2$$

limited to $F_{ax,Rk} = 400$ N

The head diameter d_h of all screws shall be greater than $1,8 \cdot d_s$, where d_s is the smooth shank or the wire diameter. Otherwise, the characteristic head pull-through capacity $F_{ax,\varepsilon,Rk} = 0$.

The minimum thickness of wood-based panels according to the clause 3.6 must be observed.

In steel-to-timber connections the head pull-through capacity may be disregarded.

Tensile capacity

The characteristic tensile strength $f_{tens,k}$ of screws is given in Section 3.1.

For screws used in combination with steel plates, the tear-off capacity of the screw head should be greater than the tensile strength of the screw.

When determining design values of the tensile capacity it should be used γ_{M2} partial factor according to EN 1993 or to the particular national annex.

Combined laterally and axially loaded screws

For connections subjected to a combination of axial and lateral load, the following expression should be satisfied:

$$\left(\frac{F_{ax,Ed}}{F_{ax,Rd}} \right)^2 + \left(\frac{F_{la,Ed}}{F_{la,Rd}} \right)^2 \leq 1$$

Where:

$F_{ax,Ed}$ axial design load of the screw

$F_{la,Ed}$ lateral design load of the screw

$F_{ax,Rd}$ design load-carrying capacity of an axially loaded screw

$F_{la,Rd}$ design load-carrying capacity of a laterally loaded screw

Thermal insulation material on top of rafters

See Annex C

3.5 Aspects related to the performance of the product

3.5.1 Corrosion protection

The WASI screws are produced from stainless steel wire. The screws are for use in timber structures subject to service classes 1, 2 and 3 of Eurocode 5. The corrosion protection is given by stainless steel no. 1.4006, 1.4301, 1.4401 or 1.4567.

Contact corrosion shall be avoided.

3.6 General aspects related to the intended use of the product

The screws are manufactured in accordance with the provisions of the ETA using the automated manufacturing process and laid down in the technical documentation.

The installation shall be carried out in accordance with Eurocode 5 or an appropriate national code unless otherwise is defined in the following. Instructions from WASI GmbH should be considered for installation.

The screws are used for connections in load bearing timber structures between members of solid timber, glued laminated timber, cross-laminated timber, laminated veneer lumber, similar glued members, wood-based panels or steel members.

The screws may be used for connections in load bearing timber structures with structural members according to an associated ETA, if according to the associated ETA of the structural member a connection in load bearing timber structures with screws according to an ETA is allowed.

The screws with diameters of at least 6 mm may also be used for the fixing of insulation on top of rafters.

A minimum of two screws should be used for connections in load bearing timber structures. This does not apply for reinforcements or for the fixing of battens, rafters, purlins or similar on main beams or top plates, if the member is fixed with at least two screws in total.

The minimum penetration depth in structural members made of solid, glued or cross-laminated timber or laminated veneer lumber is:

$$\ell_{ef,req} = \min \left\{ \frac{4 \cdot d}{\sin \varepsilon}; 20 \cdot d \right\}$$

Wood-based panels and steel plates should only be arranged on the side of the screw head. The minimum thickness of wood-based panels should be $1,2 \cdot d$. Furthermore, the minimum thickness for following wood-based panels should be:

- Plywood, Fibreboards: 6 mm
- Particleboards, OSB, Cement Particleboards: 8 mm
- Solid wood panels: 12 mm

For structural members according to ETA's the terms of the ETA's must be considered.

The screws shall be driven into softwood with or without pre-drilling.

The hole diameter in steel members must be predrilled with a suitable diameter.

Only the equipment prescribed by WASI GmbH shall be used for driving the screws.

In connections with screws with countersunk head according to Annex A, the head must be flush with the surface of the connected structural member. A deeper countersink is not allowed.

For screws arranged at angles $\alpha < 90^\circ$ between screw axis and grain direction minimum spacing and distances are defined as follows:

Minimum spacing a_1 or a_2 is defined perpendicular to the fastener axis, minimum end or edge distances $a_{3,c}$, $a_{3,t}$, $a_{4,c}$ or $a_{4,t}$ parallel or perpendicular to the grain, respectively, are defined between the centre of the threaded length (axial loading) or the length (lateral loading) in the respective timber member and the member surface as for axially loaded screws in Figure 8.11.a EN 1995-1-1.

Laterally and/or axially loaded screws

For structural timber members, minimum spacing and distances for laterally or axially loaded screws in predrilled holes are given in EN 1995-1-1:2008 (Eurocode 5) clause 8.3.1.2 and table 8.2 as for nails in predrilled holes. Here, the outer thread diameter d must be considered.

For screws in non-predrilled holes, minimum spacing and distances are given in EN 1995-1-1:2008 (Eurocode 5) clause 8.3.1.2 and table 8.2 as for nails in non-predrilled holes.

For screws in non-predrilled Douglas fir members minimum spacing and distances parallel to the grain shall be increased by 50%.

Minimum distances from the unloaded edge perpendicular to the grain may be reduced to $3 \cdot d$ also for timber thickness $t < 5 \cdot d$, if the spacing parallel to the grain and the end distance is at least $25 \cdot d$.

These requirements do not apply for structural wood-based panels or LVL with cross layers.

Minimum thickness for predrilled structural members is $t = 24$ mm for screws with outer thread diameter $d < 8$ mm, and $t = 30$ mm for screws with outer thread diameter $d = 8$ mm. These minimum thickness values generally apply for non-predrilled softwood members, if the spacing parallel to the grain and the end distance is at least $25 \cdot d$.

In all other cases, minimum thicknesses for screws in non-predrilled softwood members are given in EN 1995-1-1 (Eurocode 5) clause 8.3.1.2 as for nails in non-predrilled holes. Equation (8.18) may be applied for softwood members made of pine or for the fixing of boards, battens or wind braces, if the member is fixed with at least two screws. Otherwise EN 1995-1-1 clause 8.3.1.2 (7) applies.

Cross Laminated Timber

Unless specified otherwise in the technical specification (ETA or hEN) of cross laminated timber, minimum distances and spacing for screws in the wide face of cross laminated timber members with a minimum thickness $t = 10 \cdot d$ may be taken as (see Annex B):

Spacing a_1 parallel to the grain	$a_1 = 4 \cdot d$
Spacing a_2 perpendicular to the grain	$a_2 = 2,5 \cdot d$
Distance $a_{3,c}$ from centre of the screw-part in timber to the unloaded end grain	$a_{3,c} = 6 \cdot d$
Distance $a_{3,t}$ from centre of the screw-part in timber to the loaded end grain	$a_{3,t} = 6 \cdot d$
Distance $a_{4,c}$ from centre of the screw-part in timber to the unloaded edge	$a_{4,c} = 2,5 \cdot d$
Distance $a_{4,t}$ from centre of the screw-part in timber to the loaded edge	$a_{4,t} = 6 \cdot d$

Unless specified otherwise in the technical specification (ETA or hEN) of cross laminated timber, minimum distances and spacing for screws in the edge surface of cross

laminated timber members with a minimum thickness $t = 10 \cdot d$ and a minimum penetration depth perpendicular to the edge surface of $10 \cdot d$ may be taken as (see Annex B):

Spacing a_1 parallel to the CLT plane	$a_1 = 10 \cdot d$
Spacing a_2 perpendicular to the CLT plane	$a_2 = 4 \cdot d$
Distance $a_{3,c}$ from centre of the screw-part in timber to the unloaded end	$a_{3,c} = 7 \cdot d$
Distance $a_{3,t}$ from centre of the screw-part in timber to the loaded end	$a_{3,t} = 12 \cdot d$
Distance $a_{4,c}$ from centre of the screw-part in timber to the unloaded edge	$a_{4,c} = 3 \cdot d$
Distance $a_{4,t}$ from centre of the screw-part in timber to the loaded edge	$a_{4,t} = 6 \cdot d$

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

4.1 AVCP system

According to the decision 1997/176/EC of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) is **3**.

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD



Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark prior to CE marking.



Issued in Copenhagen on 2025-03-10 by







Thomas Bruun
Managing Director, ETA-Danmark



Annex A
Drawings of WASI screws

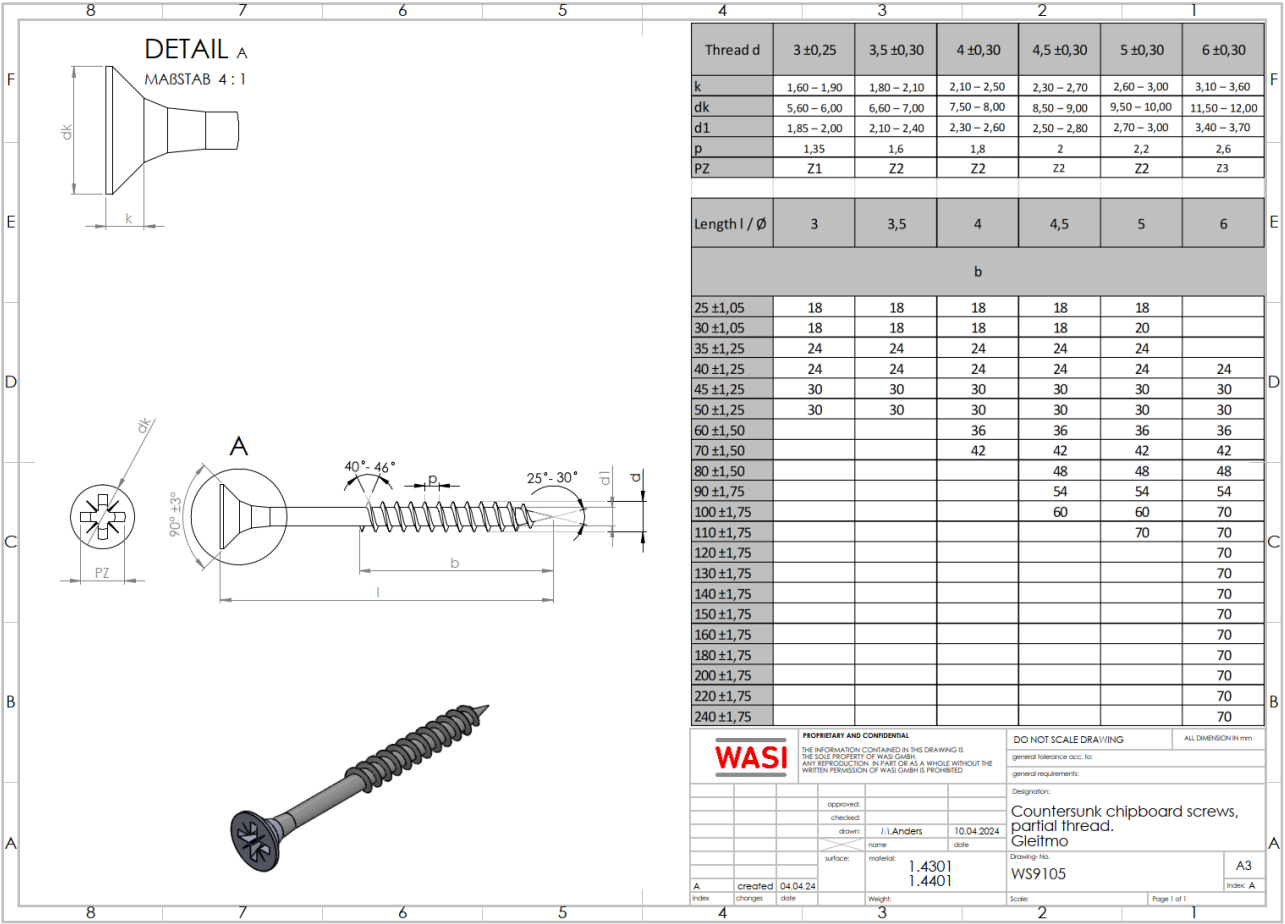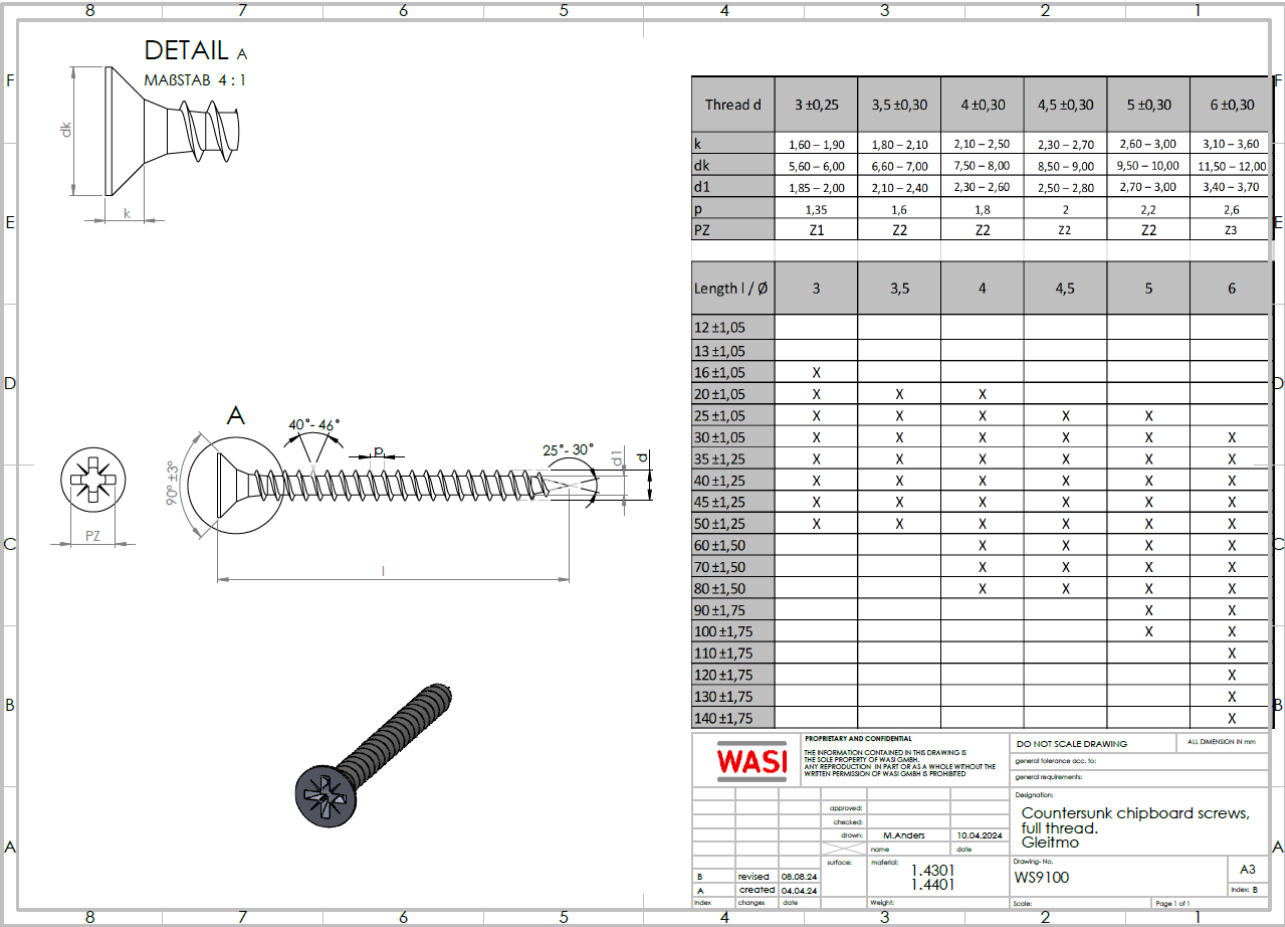


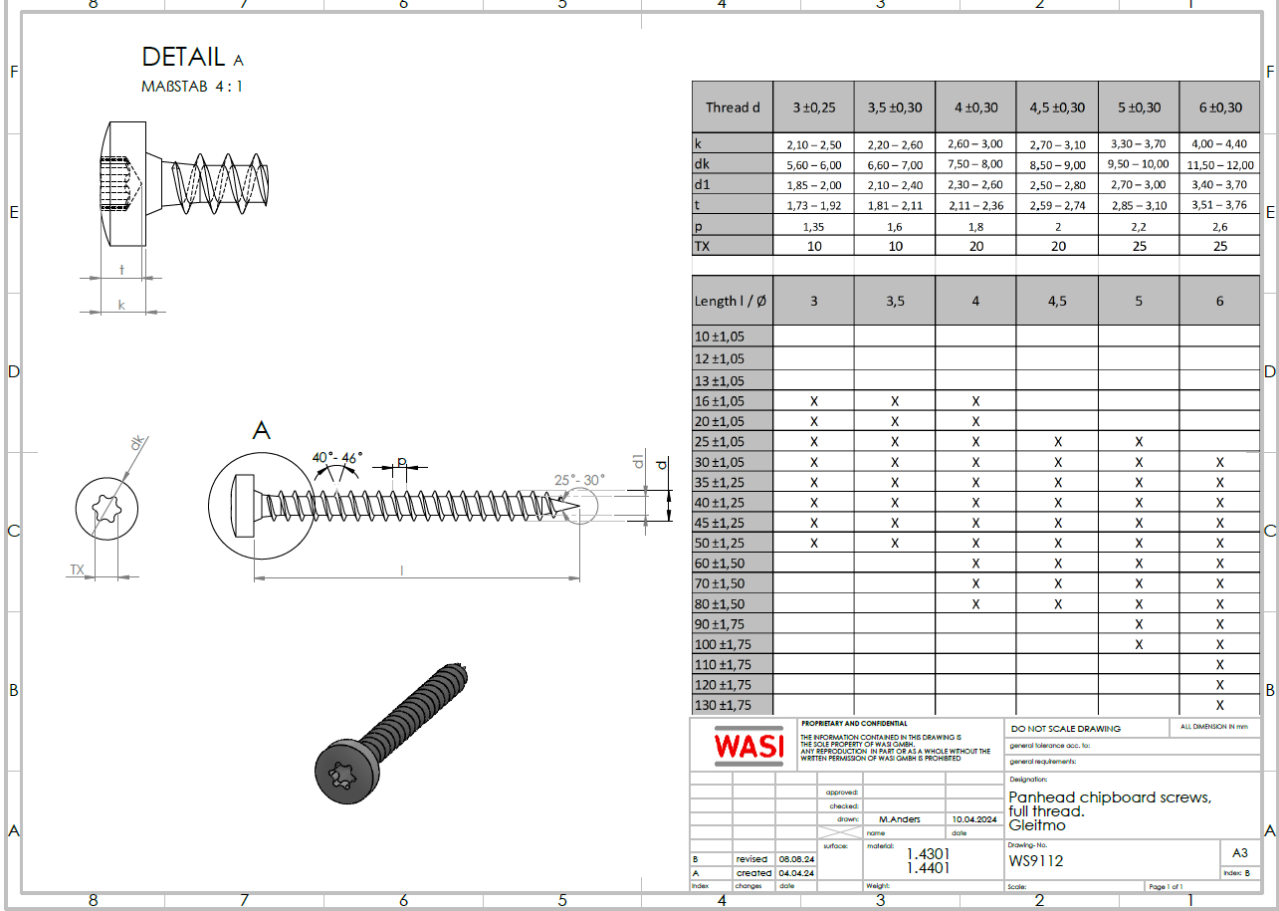
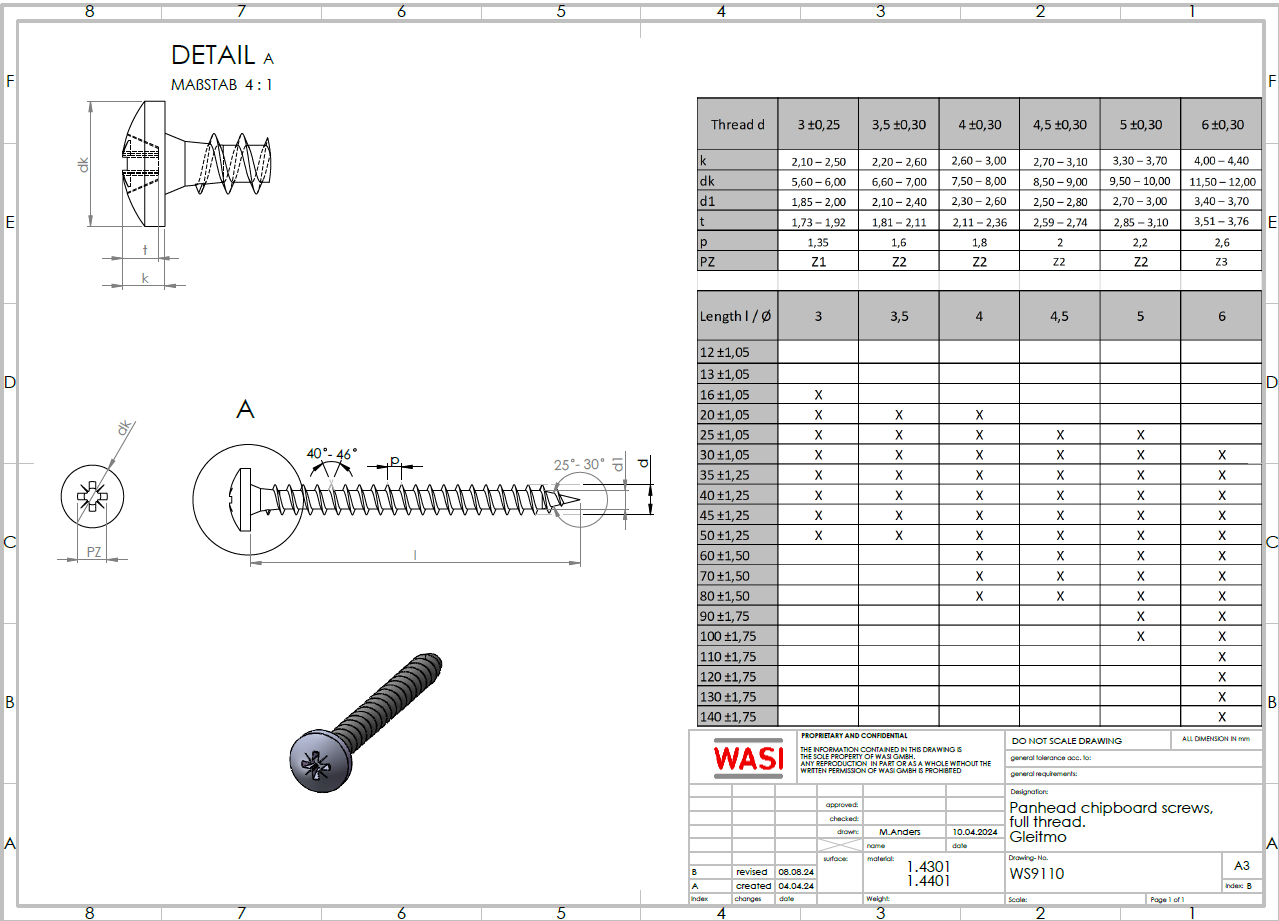


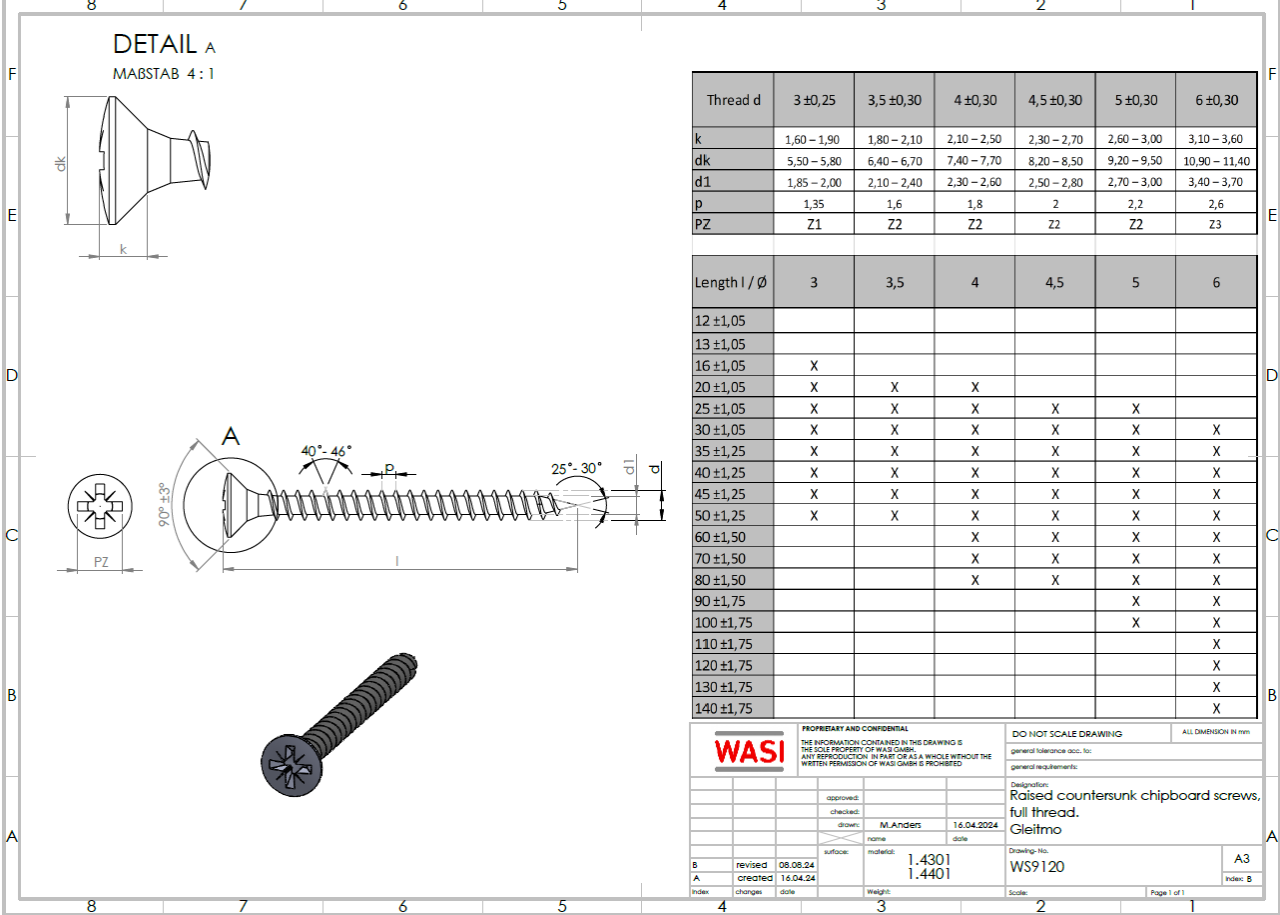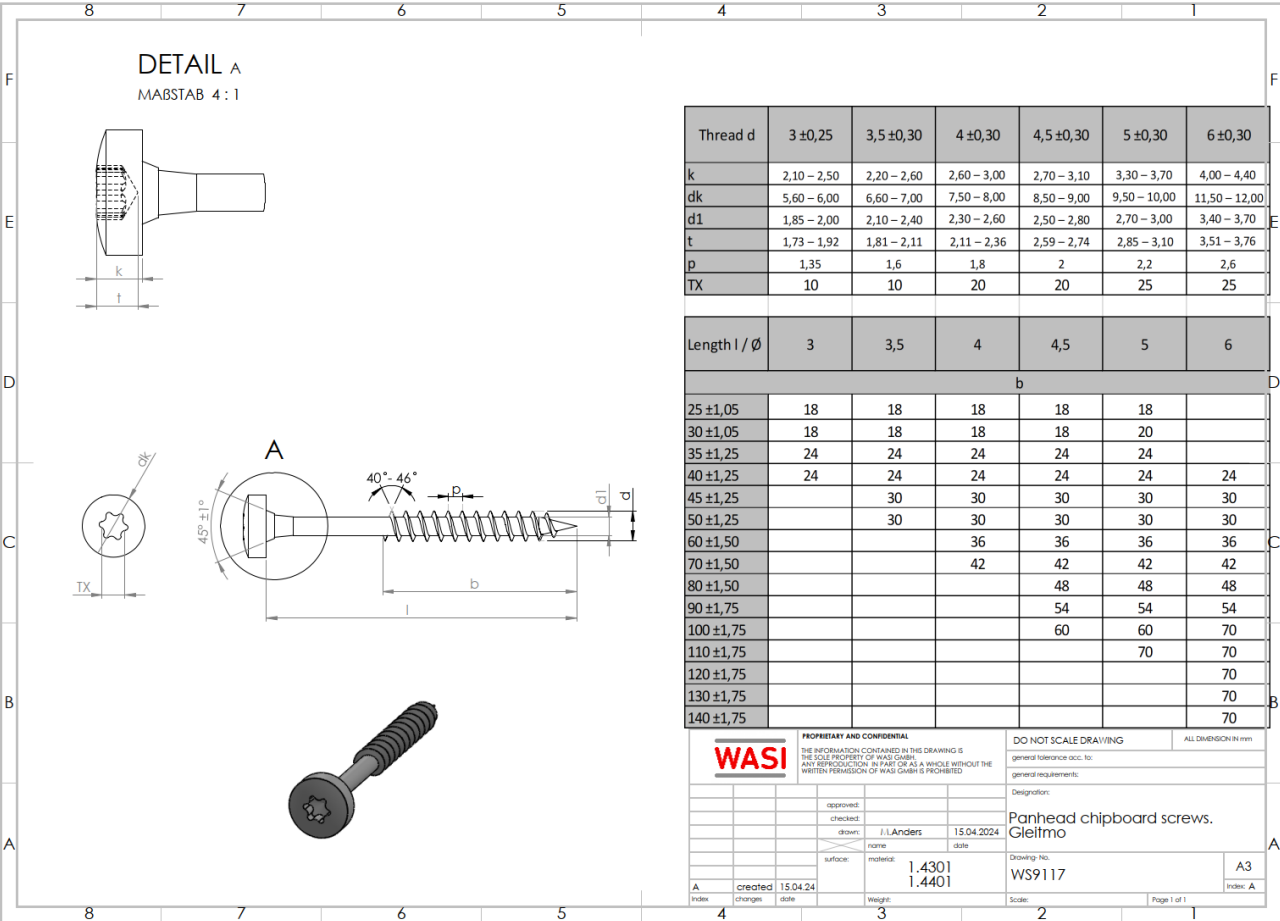

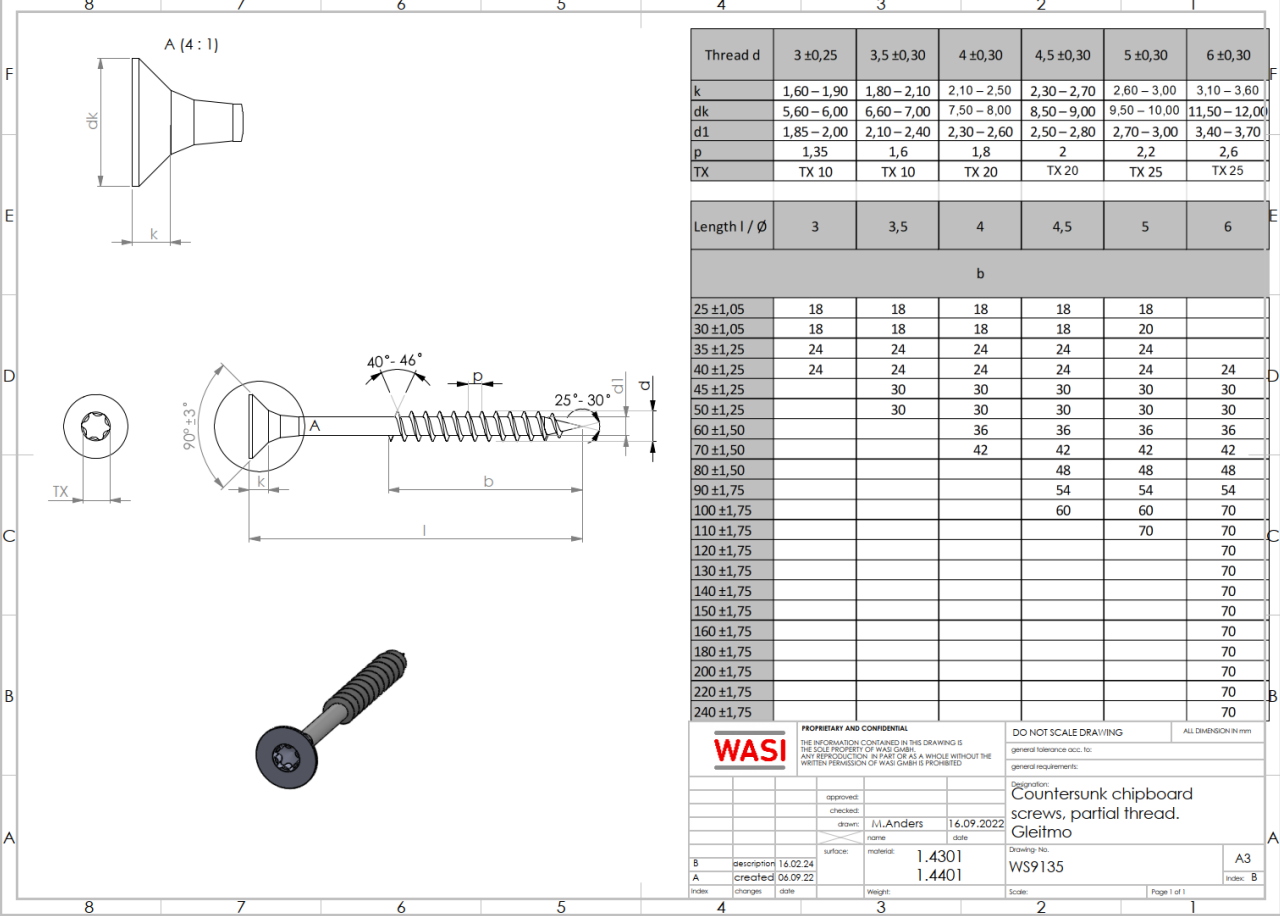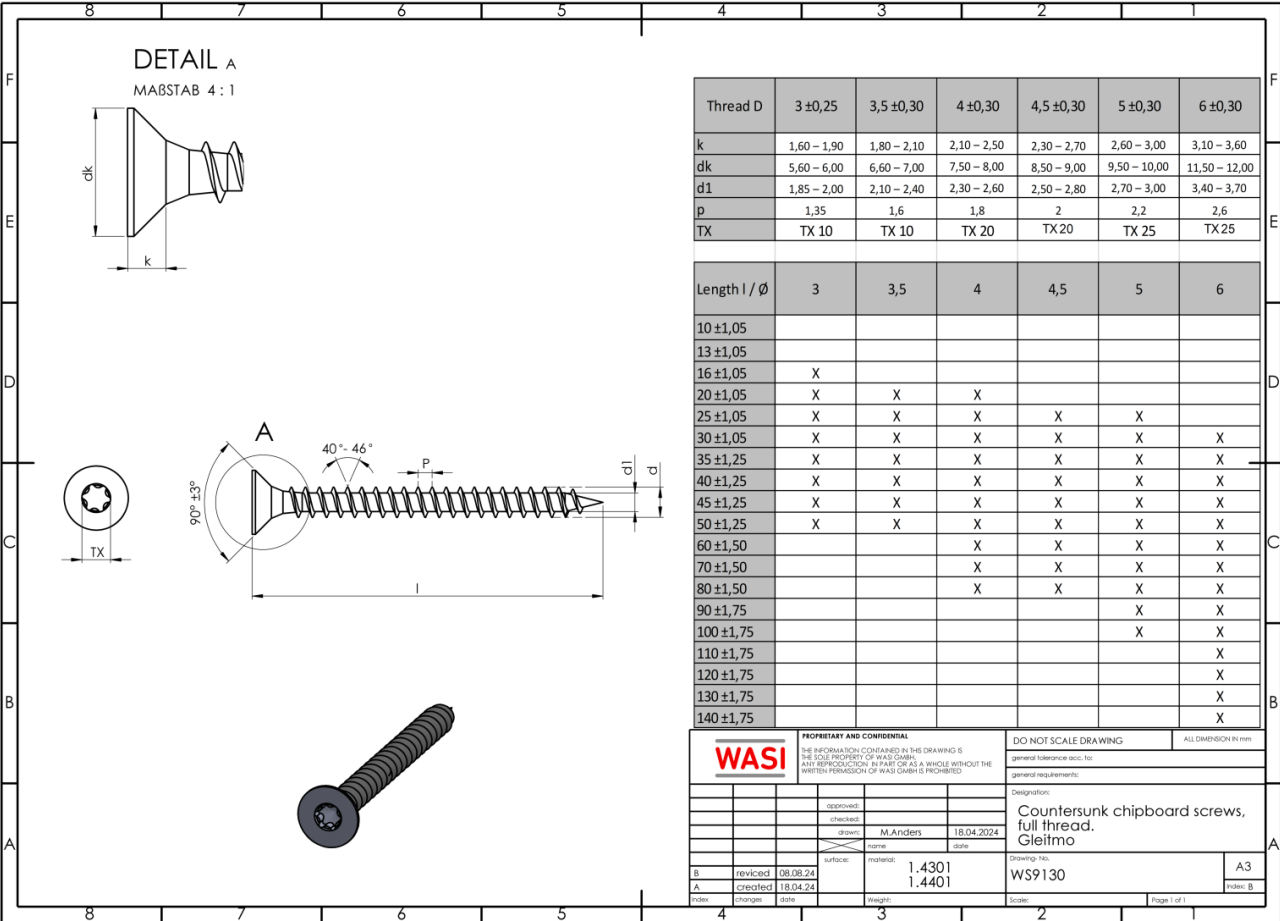

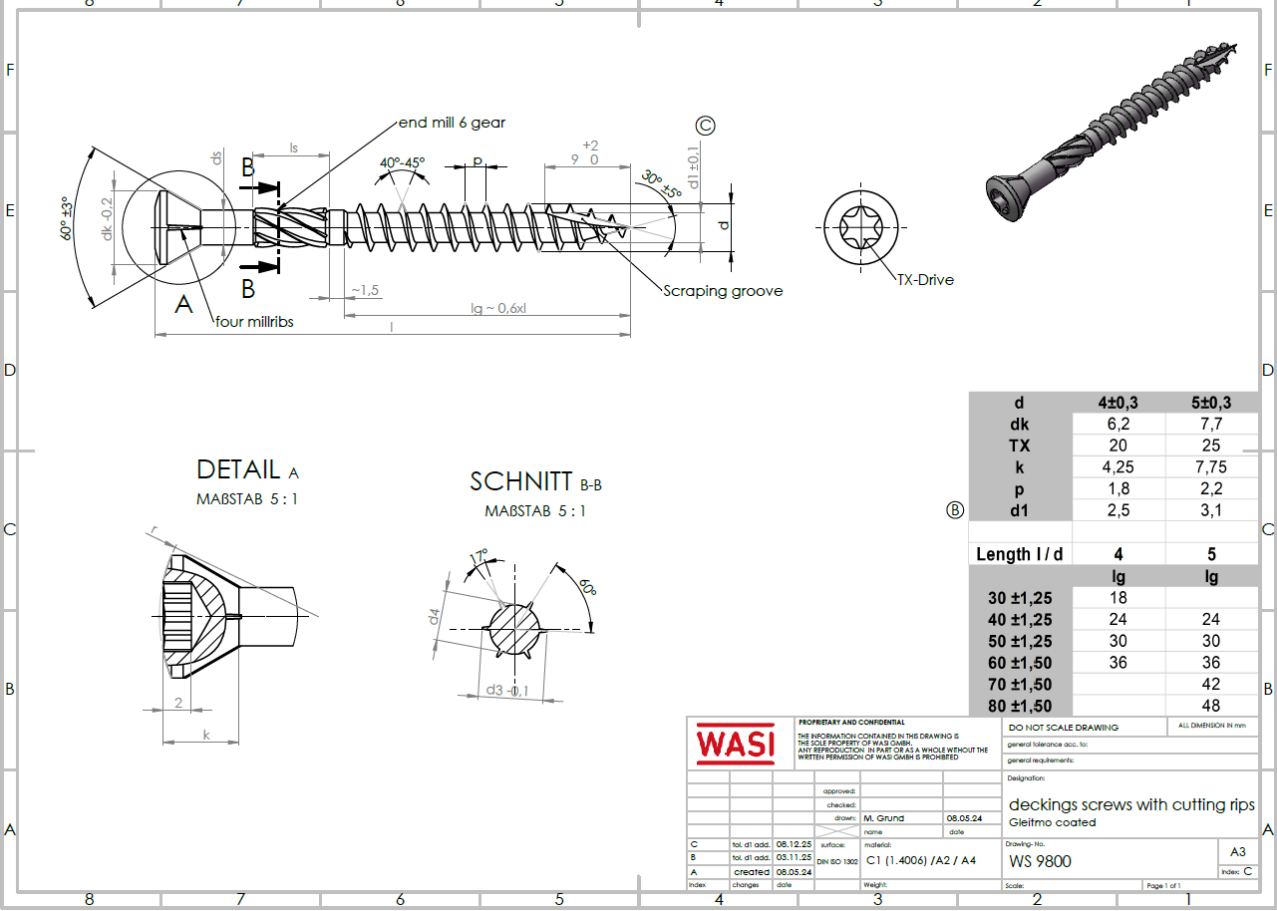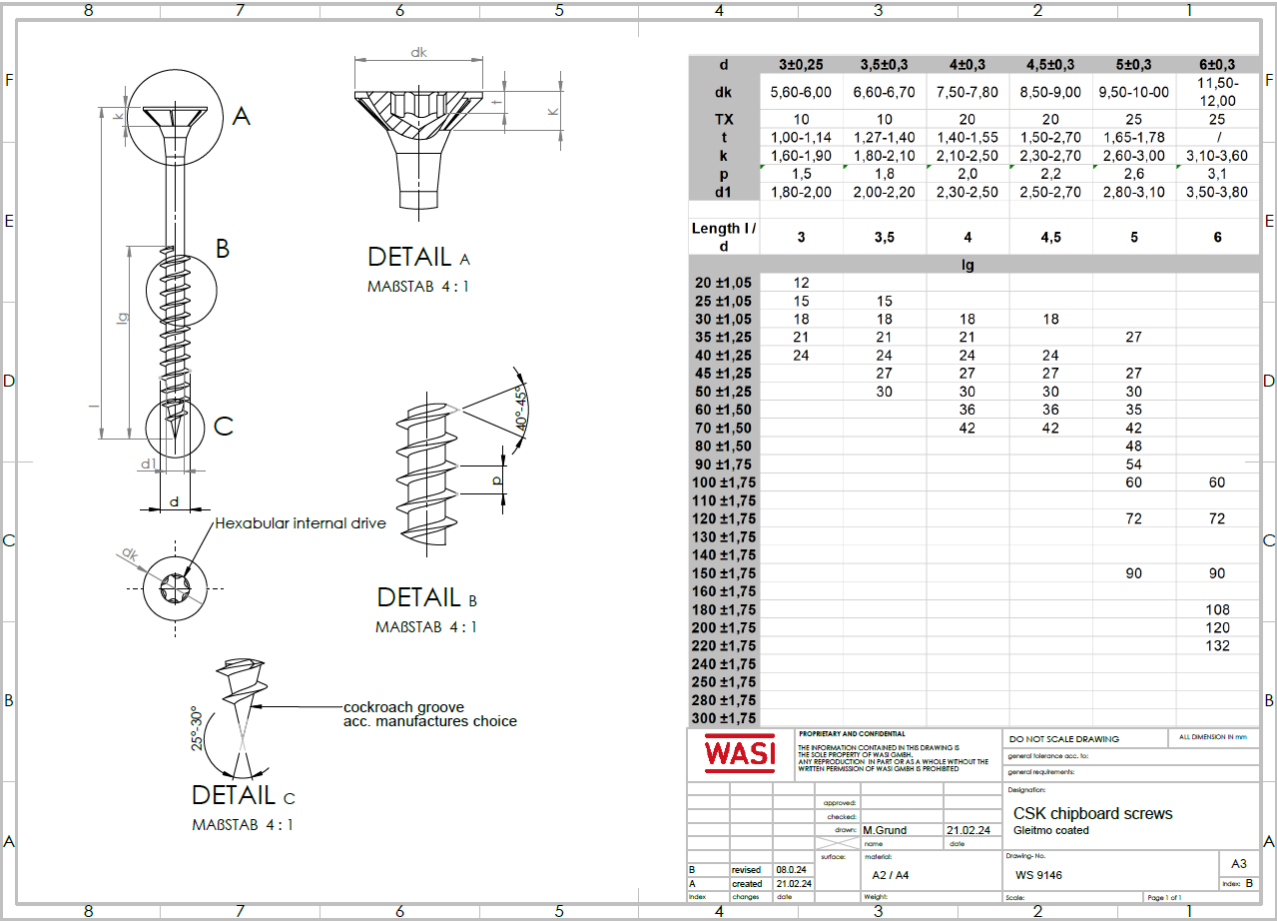

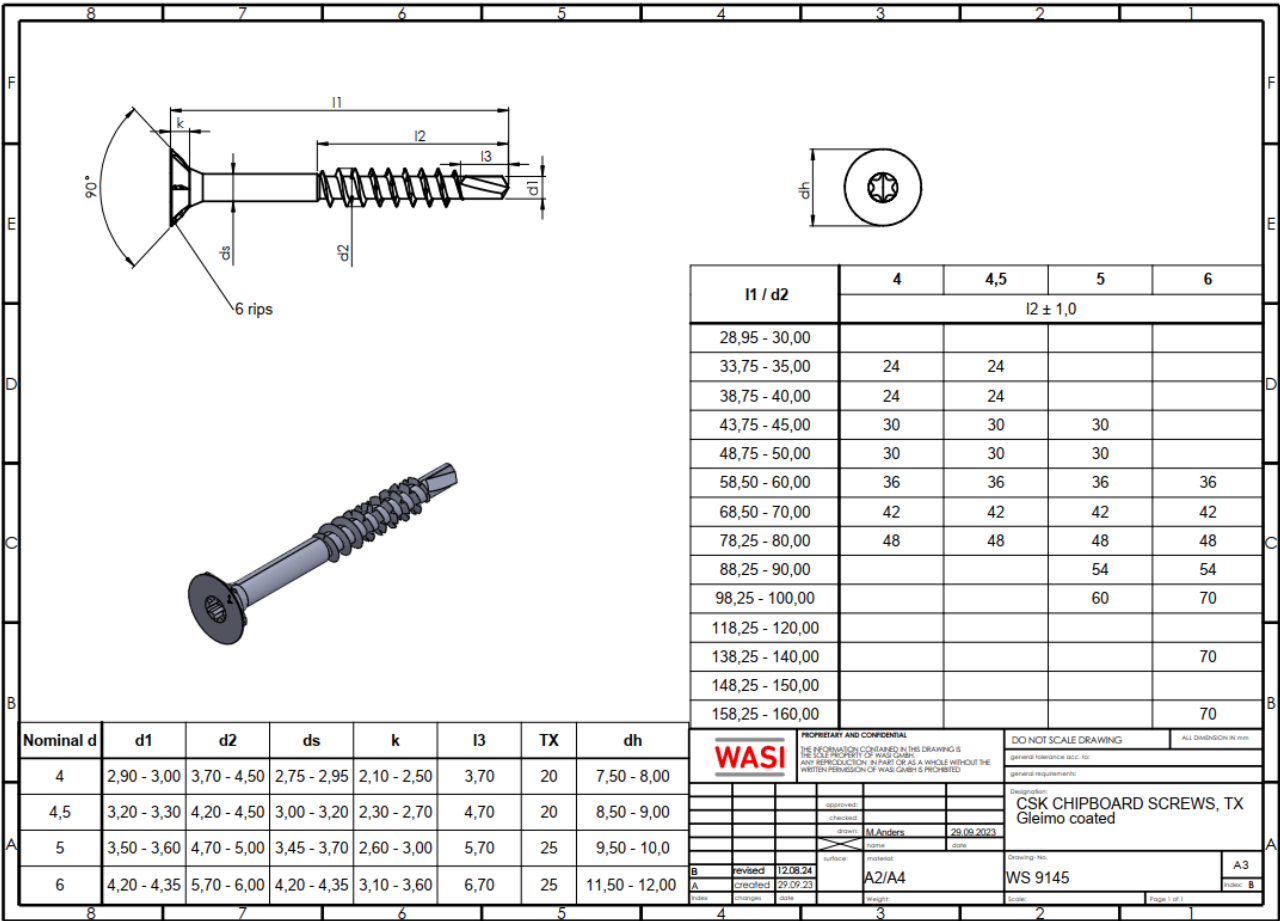

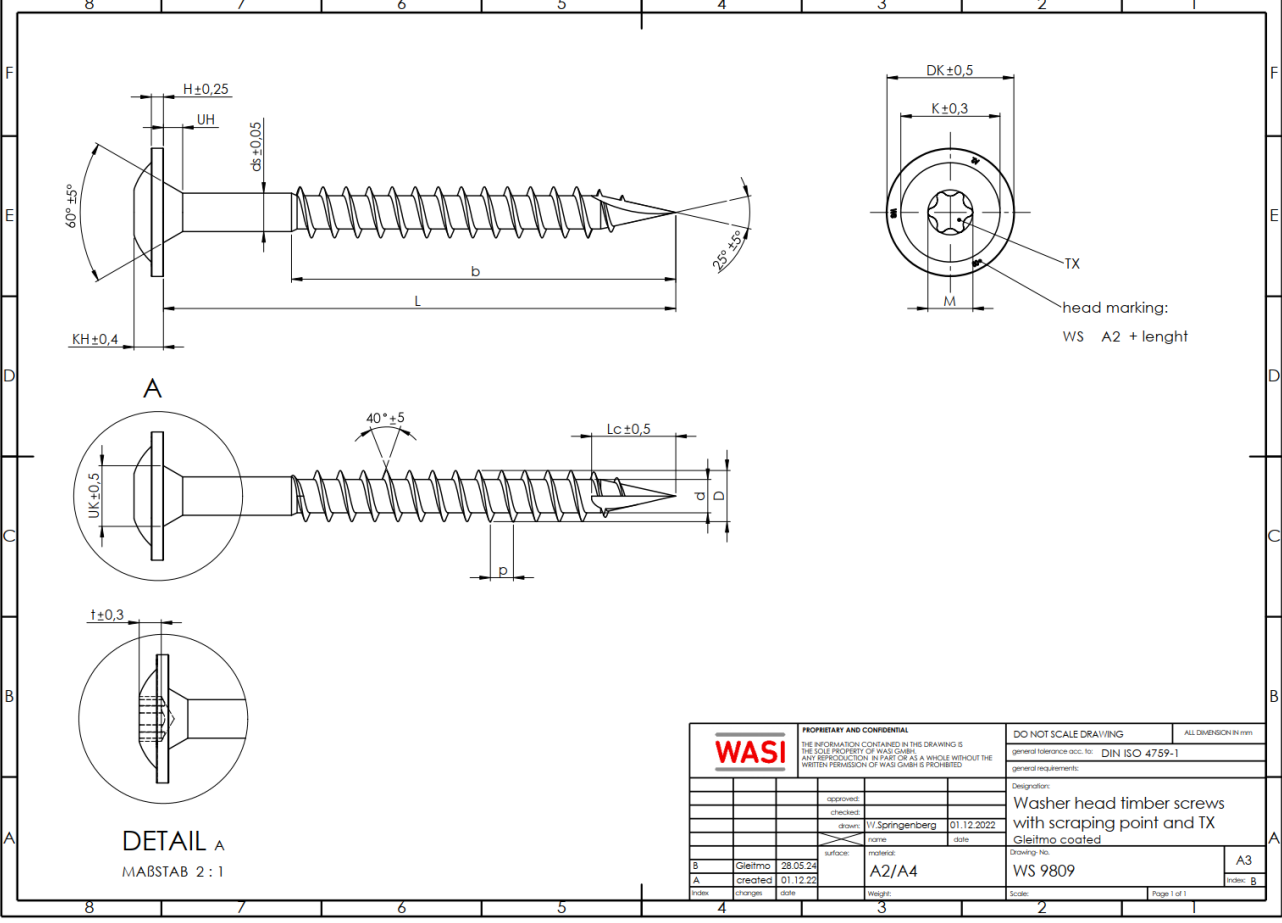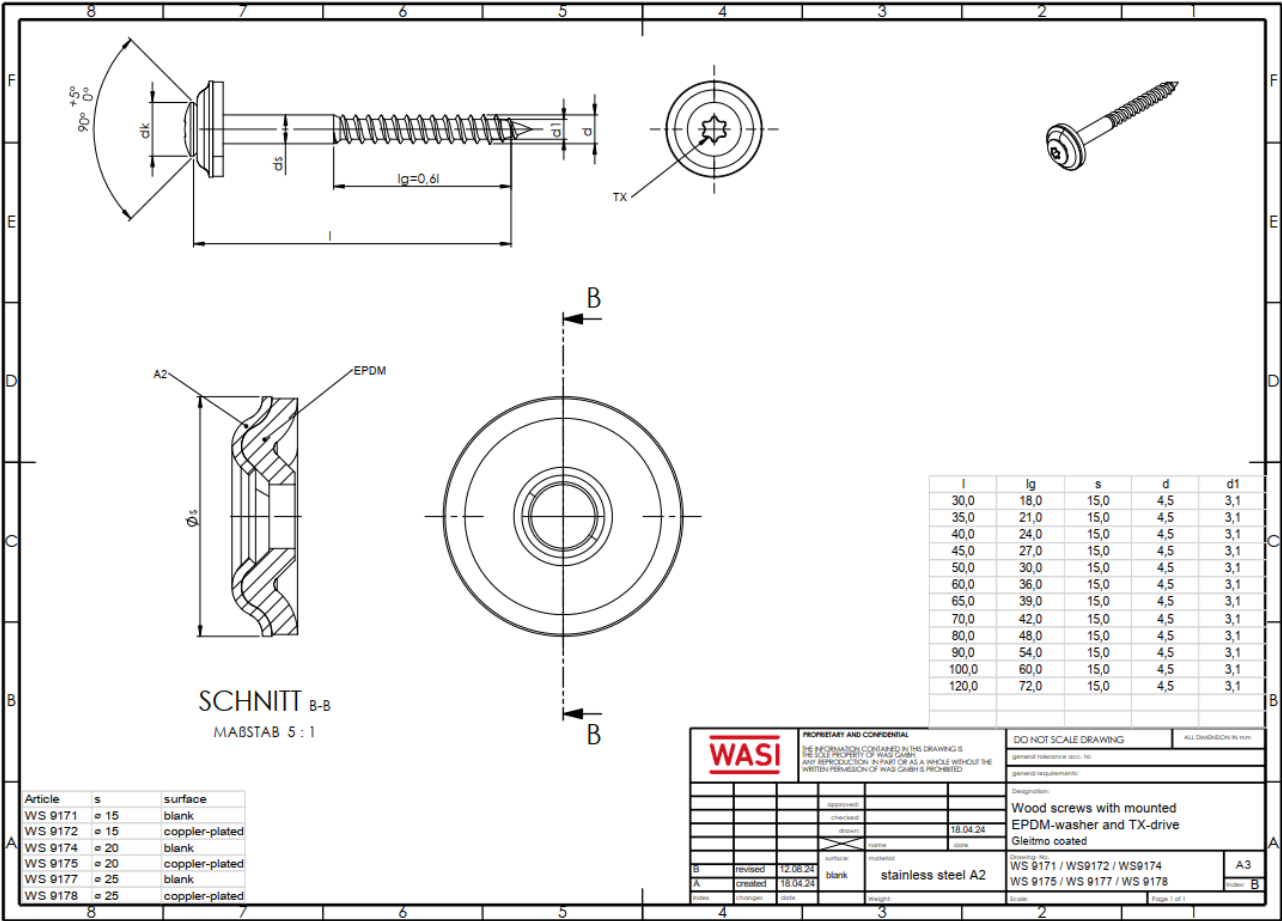

8	7	6	5	4	3	2	1
F							F
E							E
D							D
C							C
B							B
A							A
8	7	6	5	4	3	2	1

D	d	ds	KH	UH	UK	H	TX	t	DK	K	M (ref)	p	LC
Ø6	Ø3,6 +0,4	Ø4,25	3,6	2 ±0,2	Ø7,5	1,75	25	2,7	15	10,5	4,5	2,6	11,5
Ø8	Ø5,15 +0,45	Ø5,95	4,6	2,75 ±0,25	Ø9	1,9	40	3,6	19,5	14,5	6,75	3,6	13,5

Ø 6													
L	40	30	50	60	70	80	90	100	120	140	160		
tol.		-1,0			-1,5				-1,75				
b	24	20	30	36	42	48	54		70				

Ø 8													
L	40	30	50	60	70	80	90	100	120	140	160	180	200 240 280
tol.		-1,0			-1,5				-1,75				
b	40	30	50		50	72					80		


WASI		PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF WASI GMBH. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF WASI GMBH IS PROHIBITED.		DO NOT SCALE DRAWING general tolerance acc. to: DIN ISO 4759-1 general requirements:		ALL DIMENSION IN mm	
		approved:				Designation:	
		checked:				dimension table	
		drawn:	W. Springenberg	01.12.2022		Drawing No:	
		surface:	none			WS 9809	
B	Gleitmo	28.05.24				A3	
A	created	01.12.22				Index: B	
	index	changes	date			Scale:	
						Page 1 of 1	

8	7	6	5	4	3	2	1
F							F
E							E
D							D
C							C
B							B
A							A
8	7	6	5	4	3	2	1

Technical drawing of a washer head screw. The drawing shows a side view with dimensions: 3,4, ds, d3, l3, l2, l1, d2, d, and a cross-section view labeled TX with dimension dh. A label points to the thread: "six gear cord thread".


Nominal d	d1	d2	d3	ds	p	TX	l1	l2	l3
8	4,80-5,20	6,60-7,00	6,25-6,75	5,58-6,00	5,60-6,40	40	80,0 - 78,5	74,0 - 76,0 full threaded	11
8	4,80-5,20	6,60-7,00	6,25-6,75	5,58-6,00	5,60-6,40	40	100,0 - 98,5	79,0 - 81,0	11
8	4,80-5,20	6,60-7,00	6,25-6,75	5,58-6,00	5,60-6,40	40	120,0 - 118,5	79,0 - 81,0	11

WASI		PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF WASI GMBH. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF WASI GMBH IS PROHIBITED.		DO NOT SCALE DRAWING general tolerance acc. to: DIN ISO 4759-1 general requirements:		ALL DIMENSION IN mm	
		approved:				Designation:	
		checked:				Washer haed screws with high-low thread and TX Gleitmo coated	
		drawn:	M. Grund	28.09.23		Drawing No:	
		surface:	none			WS9811	
A	created	28.09.23				A3	
	index	changes	date			Index: A	
						Scale:	
						Page 1 of 1	

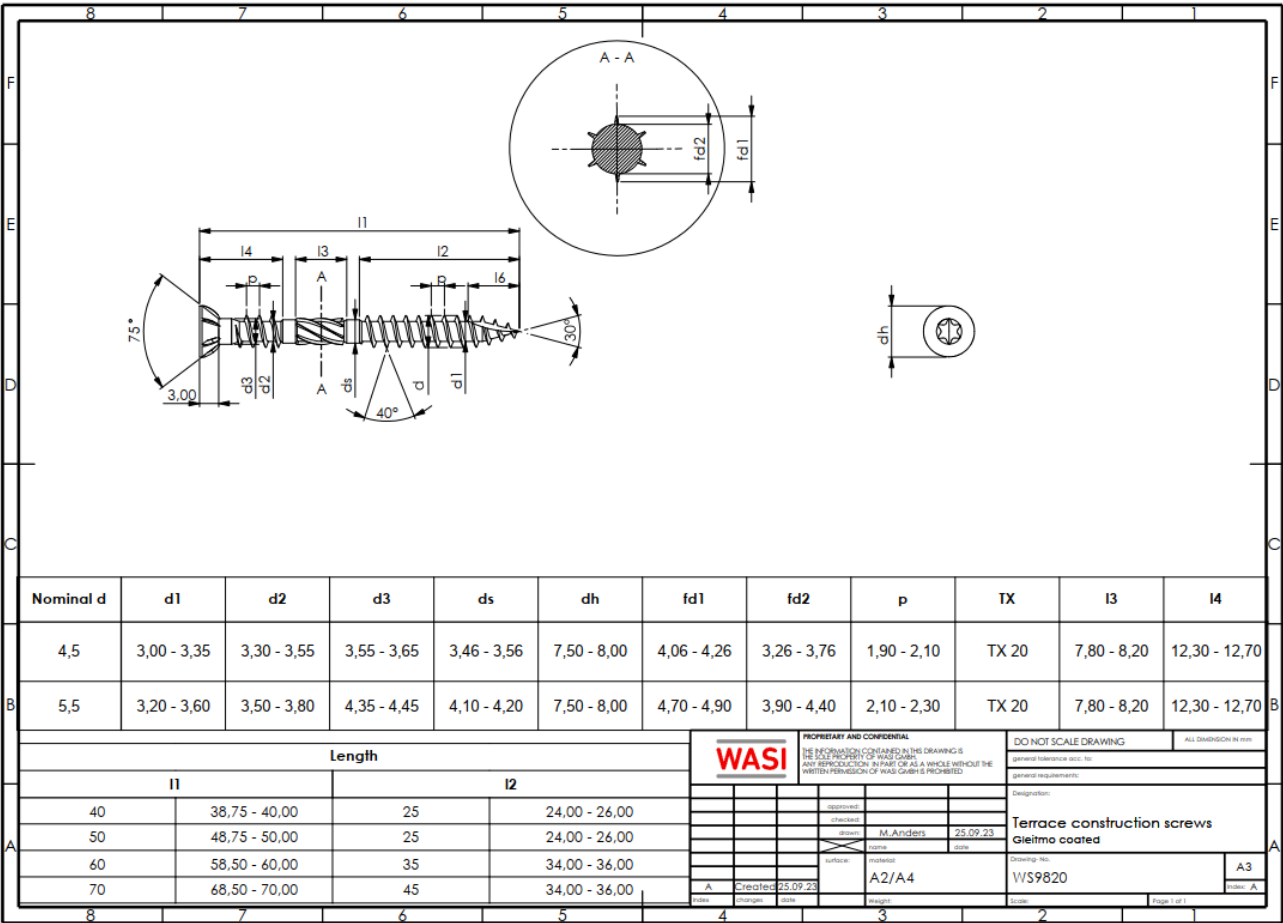

Annex B
Minimum distances and spacing
Axially or laterally loaded screws in the plane or edge surface of
cross laminated timber

Definition of spacing, end and edge distances in the plane surface unless otherwise specified in the technical specification (ETA or hEN) for the cross laminated timber:

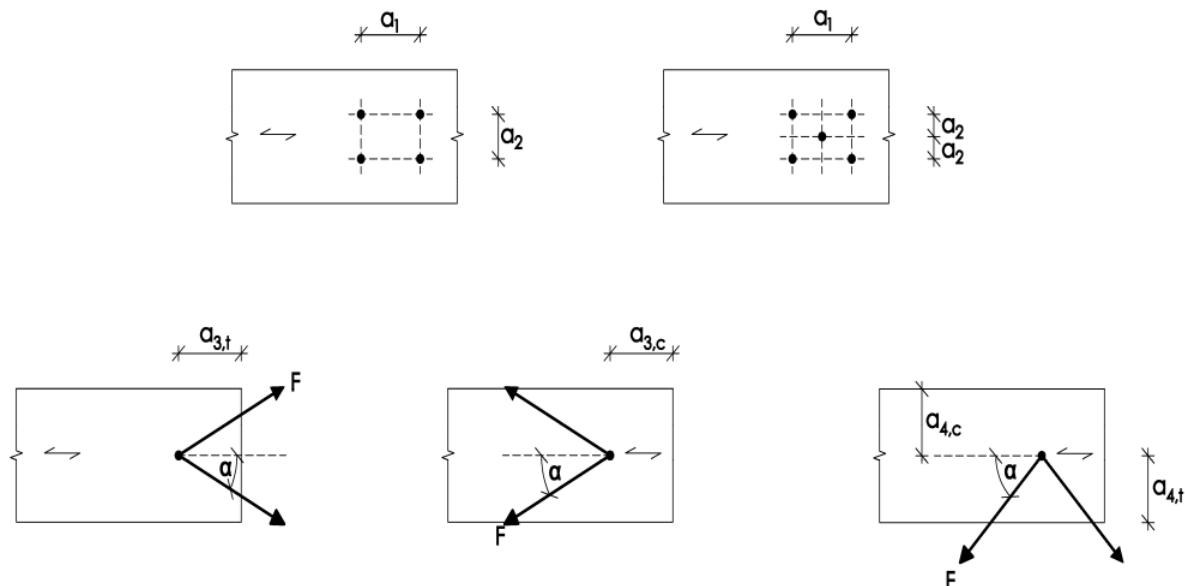

Definition of spacing, end and edge distances in the edge surface unless otherwise specified in the technical specification (ETA or hEN) for the cross laminated timber (a_1 and a_3 are parallel to the CLT plane face, a_2 and a_4 perpendicular to CLT plane face):

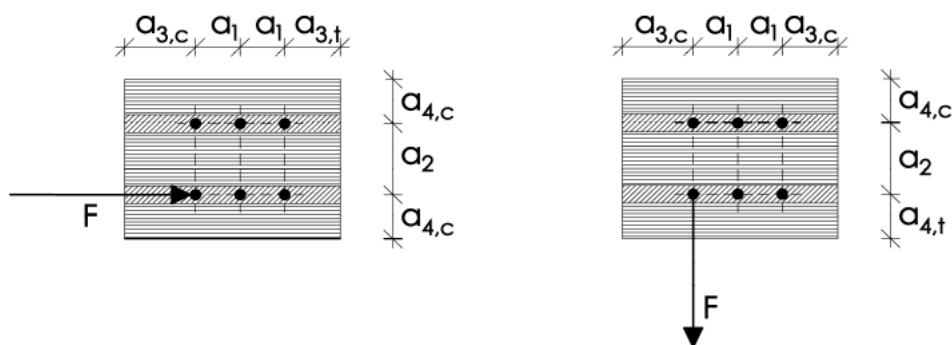


Table B1: Minimum spacing, end and edge distances of screws in the plane or edge surfaces of cross laminated timber.

	a_1	$a_{3,t}$	$a_{3,c}$	a_2	$a_{4,t}$	$a_{4,c}$
Plane surface	$4 \cdot d$	$6 \cdot d$	$6 \cdot d$	$2,5 \cdot d$	$6 \cdot d$	$2,5 \cdot d$
Edge surface	$10 \cdot d$	$12 \cdot d$	$7 \cdot d$	$4 \cdot d$	$6 \cdot d$	$3 \cdot d$

Annex C

Thermal insulation material on top of rafters or facades

WASI screws with an outer thread diameter of at least 6 mm may also be used for the fixing of thermal insulation on top of rafters.

The thickness of the insulation shall not exceed 200 mm. The rafter insulation must be placed on top of solid timber or glued laminated timber rafters or cross laminated timber members and be fixed by battens arranged parallel to the rafters or by wood-based panels on top of the insulation layer. The insulation of vertical facades is also covered by the rules given here.

Screws must be screwed in the rafter through the battens or panels and the insulation without pre-drilling in one sequence.

The angle ε between the screw axis and the grain direction of the rafter should be between 30° and 90° .

The rafter consists of solid timber (softwood) according to EN 338 or EN 14081, glued laminated timber according to EN 14081, cross-laminated timber, or laminated veneer lumber according to EN 14374 or to ETA or similar glued members according to ETA.

The battens must be from solid timber (softwood) according to EN 338:2003-04 or EN 14081. The minimum thickness t and the minimum width b of the battens is given as follows:

Screws $d < 8$ mm:	$b_{\min} = 48$ mm	$t_{\min} = 24$ mm
Screws $d = 8$ mm:	$b_{\min} = 50$ mm	$t_{\min} = 30$ mm

As an alternative to the battens, boards with a minimum thickness of 20 mm from plywood according to EN 636, particle board according to EN 312, oriented strand board OSB/3 and OSB/4 according to EN 300, solid wood panels according to EN 13353 or to ETA or national provision that apply at the installation site or cross laminated timber according to ETA may be used.

The insulation must comply with a European Technical Specification.

Friction forces shall not be considered for the design of the characteristic axial capacity of the screws.


The anchorage of wind suction forces as well as the bending stresses of the battens or the boards, respectively, shall be considered in design. Additional screws perpendicular to the grain of the rafter (angle $\varepsilon = 90^\circ$) may be arranged if necessary.

The maximum screw spacing is $e_s = 1,75$ m.

Thermal insulation on rafters with parallel inclined screws

Mechanical model

The system of rafter, thermal insulation material on top of rafter and battens parallel to the rafter may be considered as a beam on elastic foundation. The batten represents the beam, and the thermal insulation material on top of the rafter the elastic foundation. The minimum compression stress of the thermal insulation material at 10 % deformation, measured according to EN 826 (1), shall be $\sigma_{(10\%)} = 0,05 \text{ N/mm}^2$. The batten is loaded perpendicular to the axis by point loads F_b . Further point loads F_s are from the shear load of the roof due to dead and snow load, which are transferred from the screw heads into the battens. The battens or boards, respectively, must have sufficient strength and stiffness.

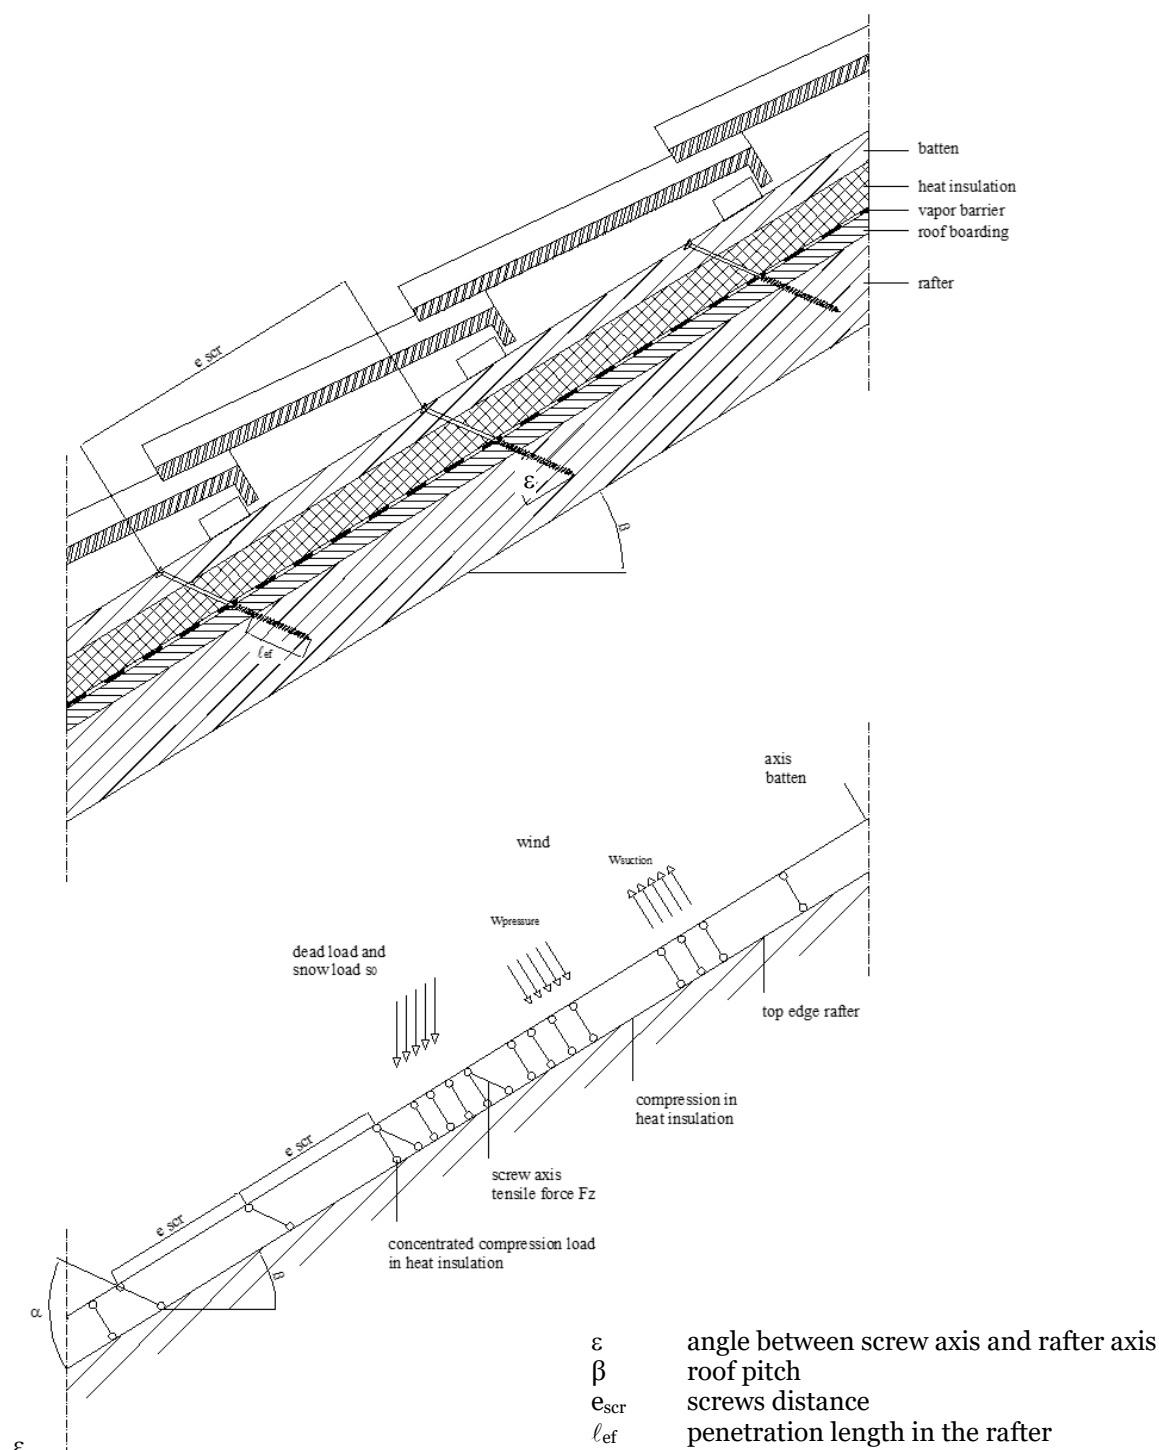

(1) EN 826:1996 Thermal insulating products for building applications - Determination of compression behaviour

Design of the battens

The bending stresses are calculated as:

$$M = \frac{(F_b + F_s) \cdot \ell_{\text{char}}}{4}$$

where

$$\ell_{\text{char}} = \text{characteristic length } \ell_{\text{char}} = \sqrt[4]{\frac{4 \cdot EI}{w_{\text{ef}} \cdot K}}$$

EI = bending stiffness of the batten

K = coefficient of subgrade

w_{ef} = effective width of the thermal insulation material

F_b = point loads perpendicular to the battens

F_s = point loads perpendicular to the battens, load application in the area of the screw heads

The coefficient of subgrade K may be calculated from the modulus of elasticity E_{HI} and the thickness t_{HI} of the thermal insulation material if the effective width w_{ef} of the thermal insulation material under compression is known. Due to the load extension in the thermal insulation material the effective width w_{ef} is greater than the width of the batten or rafter, respectively. For further calculations, the effective width w_{ef} of the thermal insulation material may be determined according to:

$$w_{\text{ef}} = w + t_{\text{HI}} / 2$$

where

w = minimum width of the batten or rafter, respectively

t_{HI} = thickness of the thermal insulation material

$$K = \frac{E_{\text{HI}}}{t_{\text{HI}}}$$

The following condition shall be satisfied:

$$\frac{\sigma_{\text{m,d}}}{f_{\text{m,d}}} = \frac{M_{\text{d}}}{W \cdot f_{\text{m,d}}} \leq 1$$

For the calculation of the section modulus W the net cross section has to be considered.

The shear stresses shall be calculated according to:

$$V = \frac{(F_b + F_s)}{2}$$

The following condition shall be satisfied:

$$\frac{\tau_{\text{d}}}{f_{\text{v,d}}} = \frac{1,5 \cdot V_{\text{d}}}{A \cdot f_{\text{v,d}}} \leq 1$$

For the calculation of the cross section area the net cross section has to be considered.

Design of the thermal insulation material

The compressive stresses in the thermal insulation material shall be calculated according to:

$$\sigma = \frac{1,5 \cdot F_b + F_s}{2 \cdot \ell_{\text{char}} \cdot w}$$

The design value of the compressive stress shall not be greater than 110 % of the compressive stress at 10 % deformation calculated according to EN 826.

Design of the screws

The screws are loaded predominantly axially. The axial tension force in the screw may be calculated from the shear loads of the roof R_s :

$$T_s = \frac{R_s}{\cos \varepsilon}$$

The load-carrying capacity of axially loaded screws is the minimum design value of the axial withdrawal capacity of the threaded part of the screw, the head pull-through capacity of the screw and the tensile capacity of the screw.

To limit the deformation of the screw head for thermal insulation material thicknesses over 200 mm or with compressive strength below 0,12 N/mm², respectively, the axial withdrawal capacity of the screws shall be reduced by the factors k_1 and k_2 :

- for screws with partial thread:

$$F_{ax,e,Rd} = \min \left\{ \frac{k_{ax} \cdot f_{ax,d} \cdot d \cdot \ell_{ef} \cdot k_1 \cdot k_2}{k_{\beta}} \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0.8} ; f_{head,d} \cdot d_h^2 \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0.8} ; f_{tens,d} \right\}$$

- for screws with full thread:


$$F_{ax,e,Rd} = \min \left\{ \begin{array}{l} \frac{k_{ax} \cdot f_{ax,d} \cdot d \cdot \ell_{ef} \cdot k_1 \cdot k_2}{k_{\beta}} \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0.8} \\ \max \left\{ f_{head,d} \cdot d_h^2 \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0.8} ; \frac{k_{ax} \cdot f_{ax,d} \cdot d \cdot \ell_{ef,b} \cdot k_1 \cdot k_2}{k_{\beta}} \cdot \left(\frac{\rho_k}{\rho_a} \right)^{0.8} \right\} \\ f_{tens,d} \end{array} \right\}$$

where:

$F_{ax,e,d}$	design value of the load-carrying capacity of axially loaded screws [N]
$f_{ax,d}$	design value of the axial withdrawal parameter of the threaded part of the screw in the rafter or batten [N/mm ²]
d	outer thread diameter of the screw [mm]
ℓ_{ef}	point side penetration length of the threaded part of the screw in the rafter, $\ell_{ef} \geq 40$ mm [mm]
$\ell_{ef,b}$	length of the threaded part in the batten including the head for tensile force [mm]
ρ_k	characteristic density of the wood-based member [kg/m ³]
ρ_a	associated density [kg/m ³]
$f_{head,d}$	design value of the head pull-through parameter of the screw [N/mm ²]
d_h	head diameter [mm]
$f_{tens,d}$	design value of the tensile capacity of the screw [N]
k_1	$\min \{1; 200/t_{HI}\}$
k_2	$\min \{1; \sigma_{10\%}/0,12\}$
t_{HI}	thickness of the thermal insulation material [mm]
$\sigma_{10\%}$	compressive stress of the thermal insulation material under 10 % deformation [N/mm ²]

If k_1 and k_2 are considered, the deflection of the battens does not need to be considered. Alternatively to the battens, panels with a minimum thickness of 20 mm from plywood according to EN 636 or an ETA or national provisions that apply at the installation site, particle board according to EN 312 or an ETA or national provisions that apply at the installation site, oriented strand board according to EN 300 or an ETA or national provisions that apply at the installation site and solid wood panels according to EN 13353 or an ETA or national provisions that apply at the installation site or cross laminated timber according to an ETA may be used.

Annex D Definition of angles in LVL

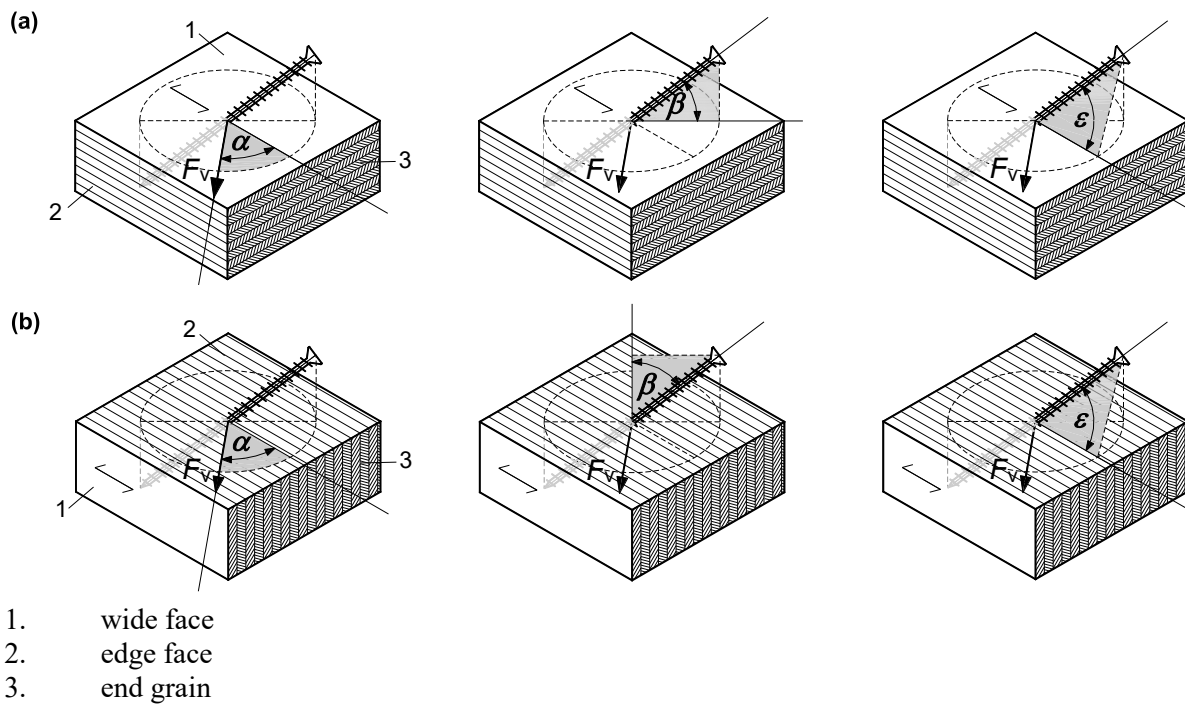

α : angle between load and grain direction ($0^\circ \leq \alpha \leq 90^\circ$)

β : angle between screw axis and the LVL's wide side ($0^\circ \leq \beta \leq 90^\circ$)

ϵ : angle between screw axis and grain direction